

RGN-B

Serisi

RGN-B

Avantaj ve Özellikler


- Kolay kurulum ve başlatma, 4 farklı modda çalıştırma seçeneği.
- PWM kontrol fonksiyonu sayesinde farklı otomasyon sistemlerinden gelen farklı akış taleplerini karşılayıp istenen motor hızını kontrolü sağlanır. Bu sayede motor hızı kontrol edilip motor gücü ayarlandığı için istenen debi ve basınçta çalışması sağlanır.
- Yüksek konforu düşük ses seviyesinde sağlayan bu ürünlerin ses seviyesi sadece 42 desibeldir.
- Avrupa Enerji Verimliliği standartlarına göre A sınıfı enerji harcar ve pompa minimum tüketimde 5 Watt a kadar düşer.
- Bu seri pompaların tamamında motor yanma riskine karşı voltaj ve yüksek akım koruması mevcuttur.

Kullanım Alanları

- Evsel Sıcak Su kullanım sistemleri. (Boyler, Akümülasyon Tankı Sekonder Devre, Re-Sirkülasyon Sistemleri.)
- Güneş Enerji Sistemleri Sekonder Devrelerde.

Çalışma Koşulları

- Sıvı Sıcaklığı. 2 °C – 110 °C
- Çalışma Ortam Sıcaklığı. 0 °C – 40 °C
- Max. Sistem Basıncı. 10 bar (1MPa)
- Koruma Sınıfı. IP44
- Çalışma Voltaj. 220V – 50/60 Hz
- Yalıtım Sınıfı. H
- Enerji. EEI<0,23

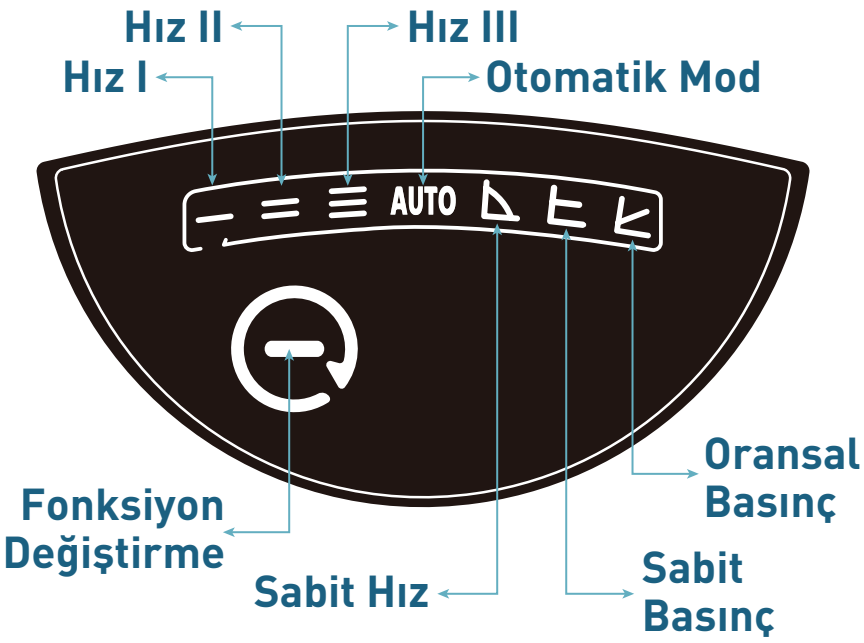

Led Güç Ekranı

- Pompanın tüketmiş olduğu elektriği anlık olarak W (Watt) cinsinden görebilirsiniz.
- Çalışma Modlarının kademelerini ayarlama imkanı.
- Çalışma Mod değiştirme düğmesi

Auto Mode

- Performans eğrisinde gösterilen değerlerde sistemin debi ihtiyacına ve sistemin büyüklüğüne göre pompa gücünü otomatik olarak ayarlayan moddur.

Sabit Hız (CS)


- Pompanın istenilen Debi talebinden hariç bağımsız olarak ayarlanabilen çalışma modudur.

Sabit Basınç (CP)

- Performans eğrisinde gösterilen sabit basınç modudur. 3 Farklı kademede çalıştırma imkanı vardır.

Oransal Basınç (PP)

- Sistemin ihtiyaçlarına göre ayarlama yapılacak moddur. Basınç düştüğünde pompa hızı artar, basınç yükseldiğinde pompa hızı düşer.

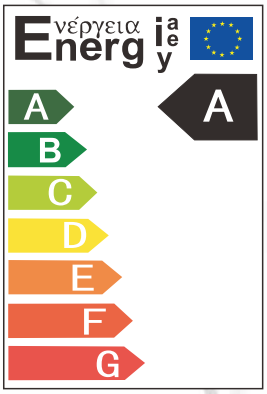


EEI⩽0.23

RGN-B

Dişli Bronz Gövde
Frekans Kontrollü
Sirkülasyon Pompası



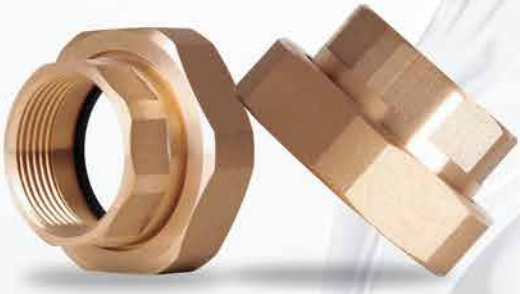


Modeller


RGN-B 25 / 8


RGN-B 32/10

RGN-B 25-8 Performans Eğrisi Tablosu

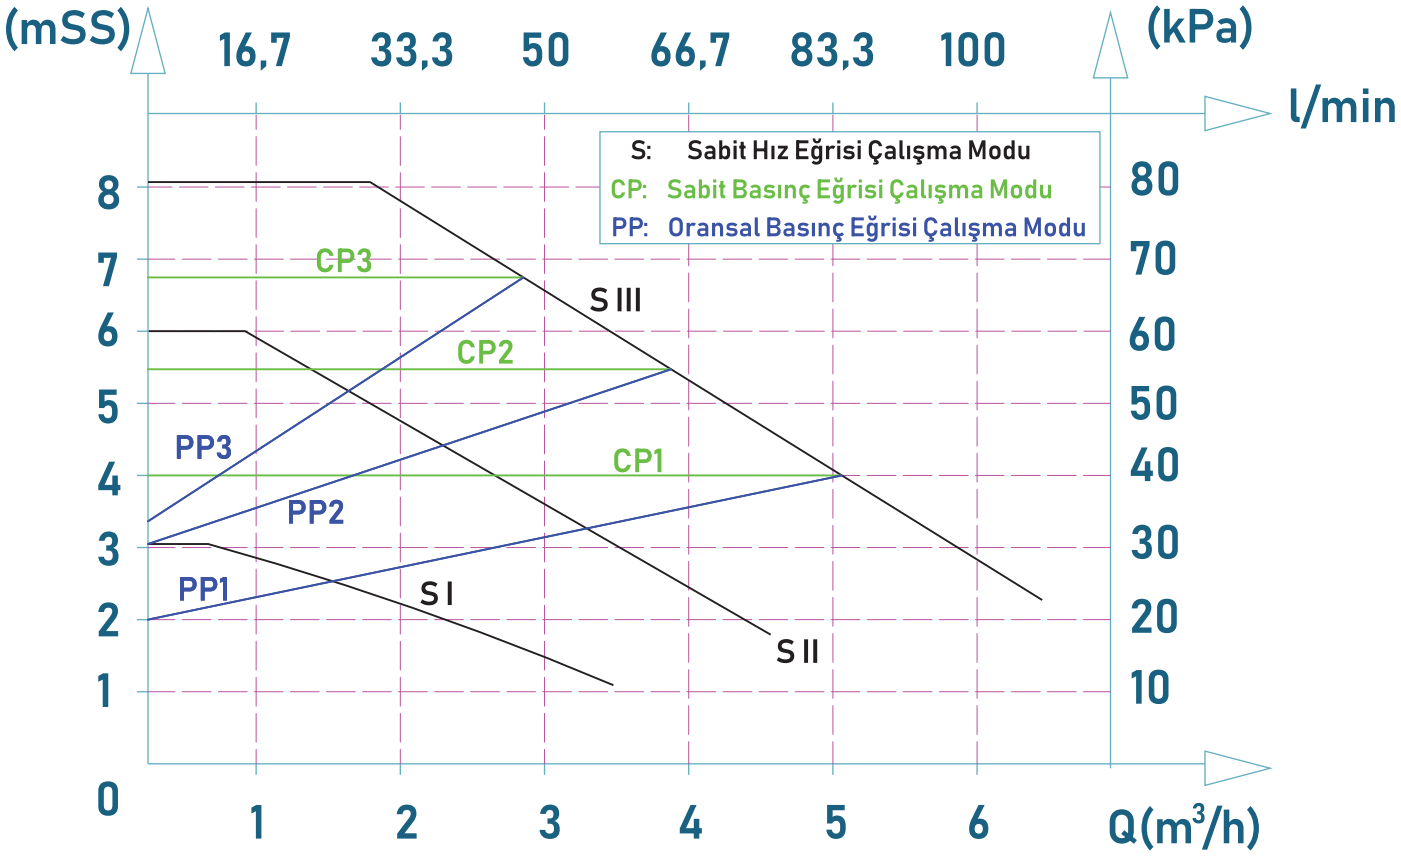


RGN-B 32-10 Performans Eğrisi Tablosu

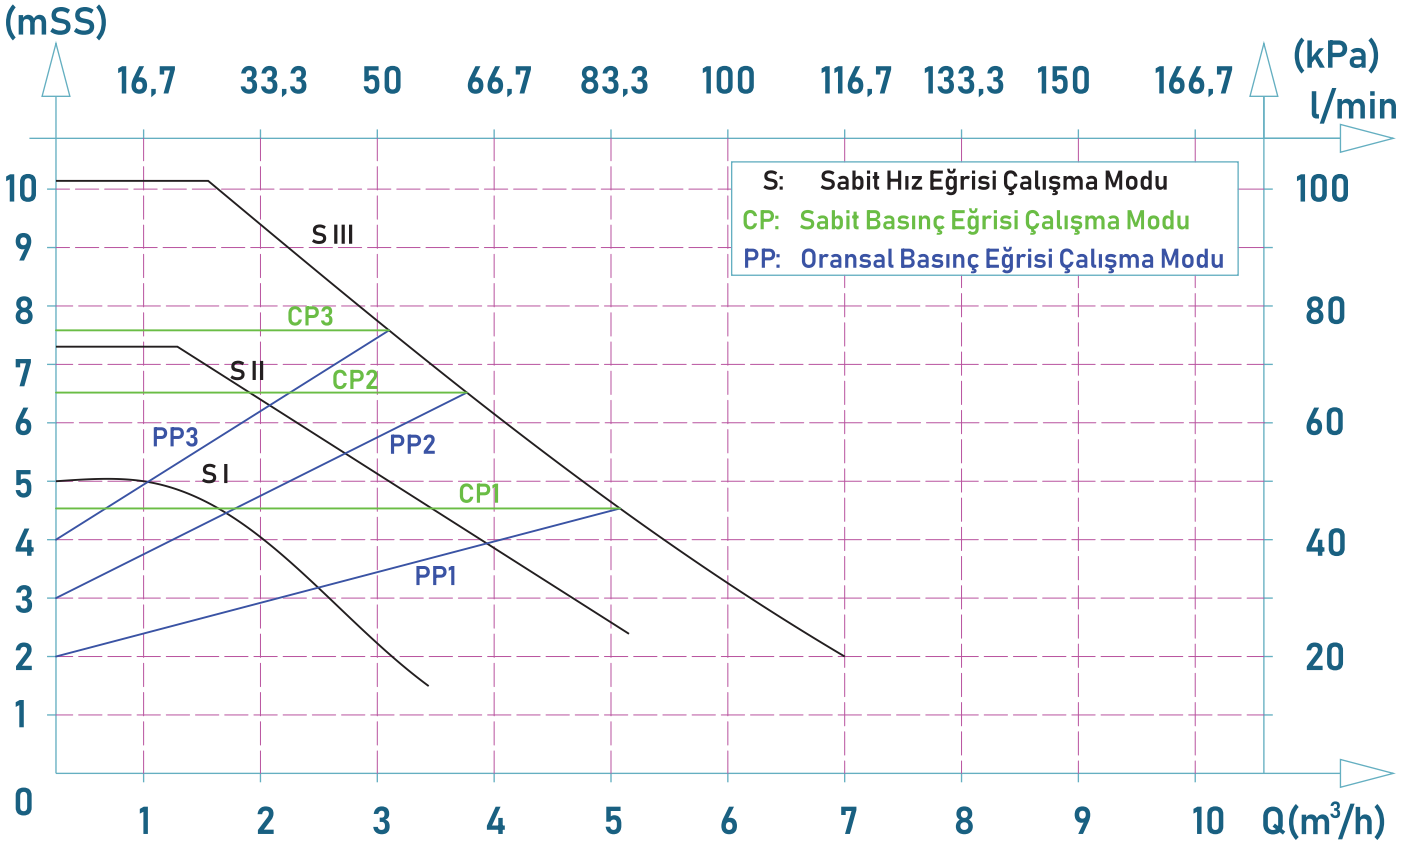

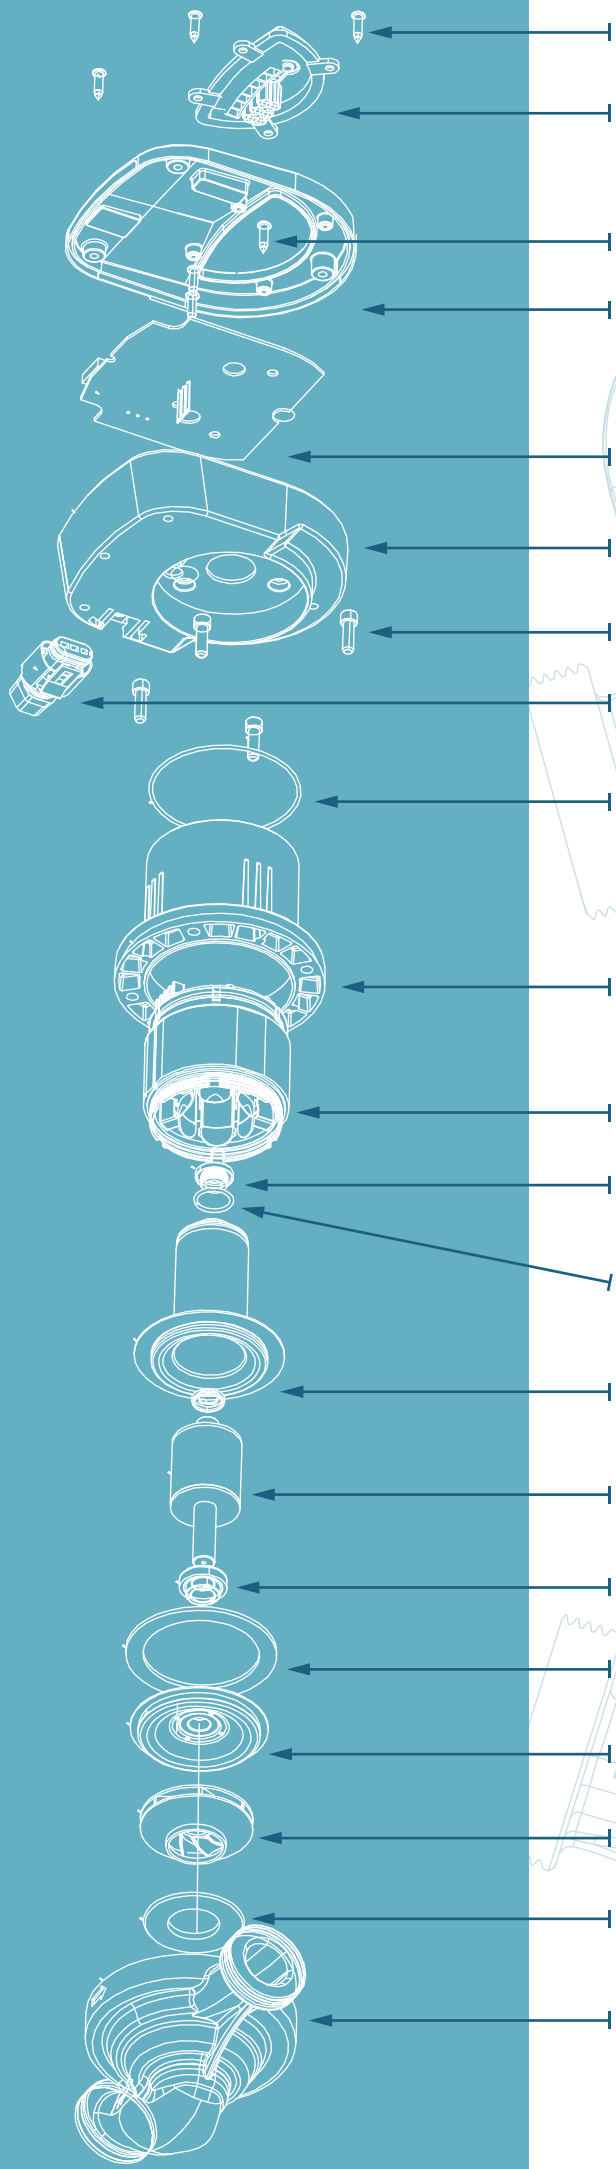

21 Vida
20 Plastik Kapak
19 Vida
18 Elektrik Kontrol Kutusu Kapak
17 Anakart
16 Elektrik Kontrol Kutusu
15 Vida Soket
14 Bağlantı Soket
13 O-Ring
12 Stator Gömleği
11 Bobin
10 Hava Alma Vidası
9 O-Ring
8 Koruyucu Kılıf
7 Rotor
6 Grafit Statik Conta
5 Conta
4 Koruma Kapağı
3 Çark
2 Paslanmaz Kapak
1 Pompa Gövde

RGN-B

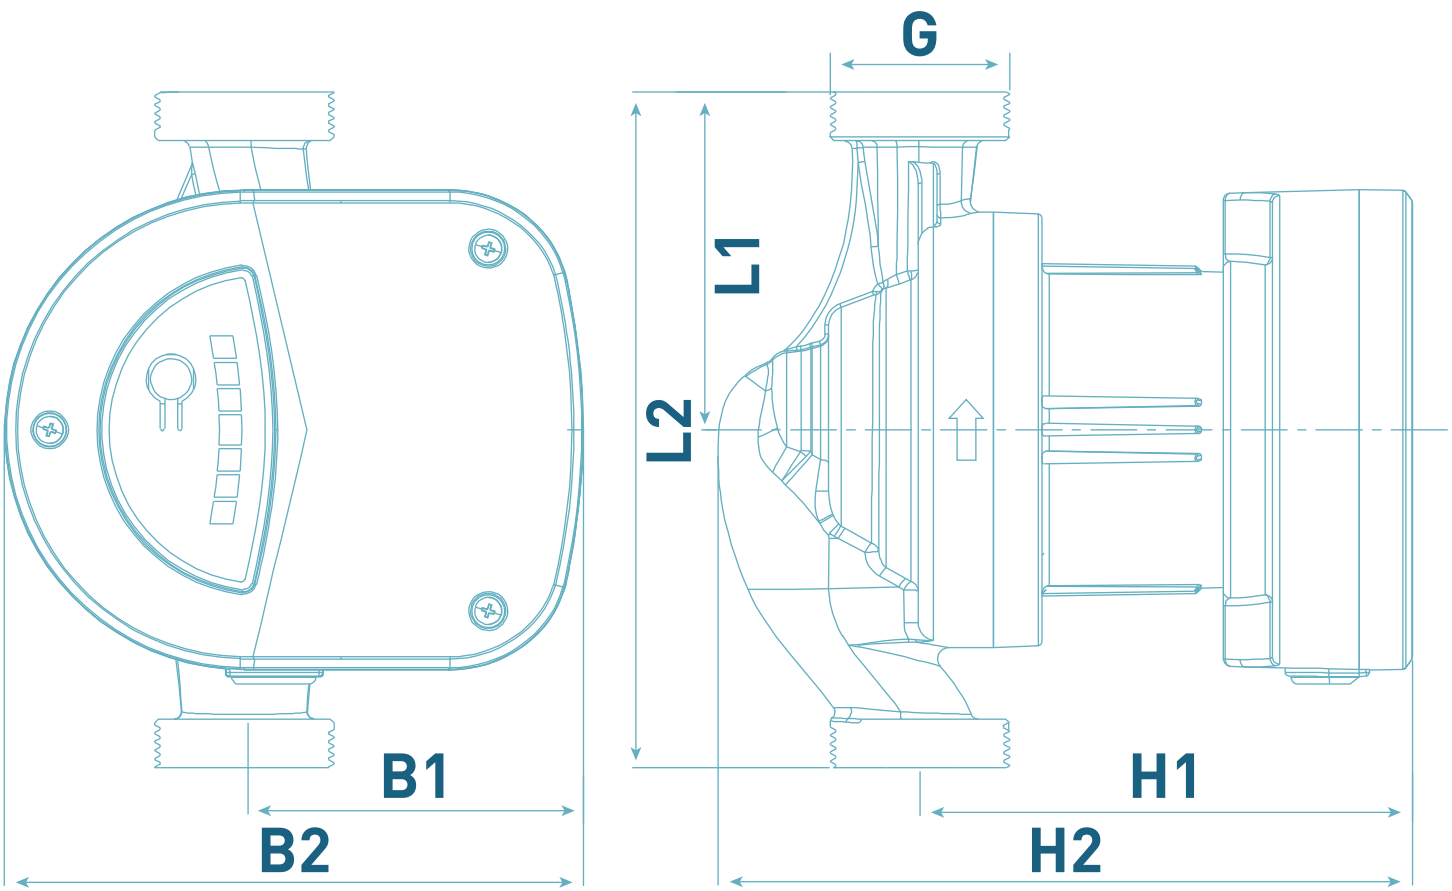

Ölçü Tablosu

Model	L1 mm	L2 mm	H1 mm	H2 mm	B1 mm	B2 mm	G inc	Bağlantı
RGN-B 25/8	90	180	131,20	184,80	89,30	154,20	1 1/2"	1 1/2" - 1"
RGN-B 32/10	90	180	131,20	184,80	89,30	154,20	2"	2"-1 1/4"

Performans Parametre Tablosu

Model	Gövde Uzunluk mm	Voltaj V	Güç W	Max. Basma Yük. m	Max. Debi m^3/h
RGN-B 25/8	180	220	120	6,5	8,0
RGN-B 32/10	180	220	150	8,0	10,0

www.qatechnic.com
info@qatechnic.com

QA-AC-7250/24

Annex

Model List

NO.	Model	Rated voltage (V)	Rated frequency (Hz)	Power (W)	Hmax (m)	Qmax (L/min)	I.C.	IP
1	RGN-B 25/8	220-240	50/60	120	8	108	H	44
2	RGN-B 32/10	220-240	50/60	150	10	133	H	44
3	RGN 32/18FX	220-240	50/60	260	18	183	H	44
4	RGN 25/7F	220-240	50/60	52	7	58	H	44
5	RGN 40 FX	220-240	50/60	340	10	233	H	44
6	RGN 40/12 FX	220-240	50/60	630	12	367	H	44
7	RGN 40/18 FX	220-240	50/60	900	18	417	H	44
8	RGN 50/18 FX	220-240	50/60	1000	18	517	H	44
9	RGN 80/15 FX	220-240	50/60	1314	12	1100	H	44
10	RGN 25/8FX	220-240	50/60	120	8	108	H	44
11	RGN 32/10FX	220-240	50/60	150	10	133	H	44
12	RGN 25/6F	220-240	50/60	52	7	58	H	44
13	RGN 50 FX	220-240	50/60	560	12	383	H	44
14	RGN 65 FX	220-240	50/60	1300	15	783	H	44

Latif Murat YILMAZ

ALBERK QA INTERNATIONAL TECHNICAL CONTROL AND CERTIFICATION CORPORATION
ADDRESS: KÜÇUKBAKKALKÖY DISTRICT
KAYIŞDAĞI STREET
TAHSİN ARICI BUSINESS CENTER
BUILDING NUMBER 13 FLOOR 1 FLAT 4
ATAŞEHİR/İSTANBUL/TÜRKİYE
TEL : + 90 216 572 49 10 (pbx)
FAKS : + 90 216 572 49 14

CERTIFICATE

QA-AC-7250/24

QA TECHNIC - ATTESTATION OF CONFORMITY

2006/42/EC MACHINERY DIRECTIVE
2014/35/EU LOW VOLTAGE DIRECTIVE
2014/30/EU ELECTROMAGNETIC COMPATIBILITY DIRECTIVE

GLOBAL ISITMA SOGUTMA SANAYI VE TICARETLTD.STI.

10031 SOKAK NO: 19 ITOB OSB TEKELI KOYU MENDERES IZMIR

Manufacturing Address	:	
Product (s)	:	Circulation Pump
Product Type (s) / Model (s)	:	As per Annex
Applicable EC Directive (s)	:	2006/42/EC, 2014/35/EU, 2014/30/EU
Applicable Harmonized Standard(s)	:	EN 60335-1:2012+AC:2014+A11:2014+A13:2017 +A1:2019+A14:2019+A2:2019+A15:2021; EN IEC60335-2-41:2021+A11:2021; EN 62233:2008; EN IEC 55014-1:2021; EN IEC 55014-2:2021; EN IEC61000-3-2:2019+A1:2021; EN 61000-3-3:2013+A2:2021; EN 809:1998+A1:2009/AC:2010
Test Report / TCF (s) and Date (s)	:	Ningbo Tongpu Testing Technology Co., Ltd. TP240829TF01/S-0433; 03.09.2024 TP240829TF02/M-0433; 03.09.2024 TP240829TF03/E-0433; 03.09.2024

The Present certificate is valid just for the analysed product design. The certificate shall lose its validity in case of any changes in the product.Ultimate responsibility related with conformity of product with directive / directives, belongs to the manufacturer.

Ultimate responsibility regarding the affixing of CE mark according to relavant regulations and legal legislation, belongs to the manufacturer.

Certificate Issue Date : 6.09.2024
Certificate Expiry Date: 6.09.2029

Latif Murat YILMAZ
General Manager

ALBERK QA INTERNATIONAL TECHNICAL CONTROL AND CERTIFICATION INC.
Küçükbakkalköy Mahallesi
Kayışdağı Caddesi
No: 13 İç Kapı No: 1
Ataşehir / İstanbul / TÜRKİYE

Tel : 0216 572 49 10-11-12
Fax : 0216 572 49 14

www.qatechnic.com

Certificate – Сертификат – 證明書 – Certificat – 증명서 – شهادة

Form QAT_10-M05, version 03, effective since June 19th, 2023

CERTIFICATE

No. 2S240515.GISDO32

Certificate's Holder: Global Isıtma Soğutma Sanayi ve Tic. Ltd. Şti.
İTOB OSB 10031 Sk. No:19 Menderes / İzmir / Türkiye

Certification ECM Mark

Product: Circulation Pump

Model(s): RGN 15/4, RGN 15/6, RGN 25/6 F, RGN 25/7 F, RGN 25/8 FX, RGN 32/10 FX, RGN 32/12 FX, RGN 32/18 FX, RGN 40 FX, RGN 40/12 FX, RGN 40/18 FX, RGN 50 FX, RGN 50/12 FX, RGN 50/18 FX, RGN 65 FX, RGN 80/15 FX, RGN-B 25/8, RGN-B 32/10

Verification to: Standard:
EN 60335-1:2012/A15:2021,
EN IEC 60335-2-41:2021/A11:2021, EN 62233:2008,
EN 55014-1:2017/A11:2020, EN IEC 55014-2:2021,
EN 61000-3-2:2014, EN 61000-3-3:2013

related to CE Directive(s):
2014/35/EU (Low Voltage)
2014/30/EU (Electromagnetic Compatibility)


Remark:
The manufacturer has voluntarily decided to submit its documents concerning the above-mentioned product for verification. Ente Certificazione Macchine confirms that the documentation made available and immediately returned to it, as containing sensitive data, meets the essential requirements of the above-mentioned directive/standard. The verification activity carried out exclusively concerned the technical documentation and no verification was carried out on the product. This document cannot replace the EC Declaration of Conformity. This document was issued in accordance with regulation RGVOL01 published on the website of www.entecerma.it and concerning voluntary certifications with a non-notified procedure.

Issuance date: 15 May 2024
Expiry date: 14 May 2029

For online check:

Approver
Ente Certificazione Macchine
Legal Representative
Luca Bedonni

Ente Certificazione Macchine Srl
Via Ca' Bella, 243 – Loc. Castello di Serravalle – 40053 Valsamoggia (BO) - ITALY
☎ +39 051 6705141 🖷 +39 051 6705156 ✉ info@entecerma.it 🌍 www.entecerma.it

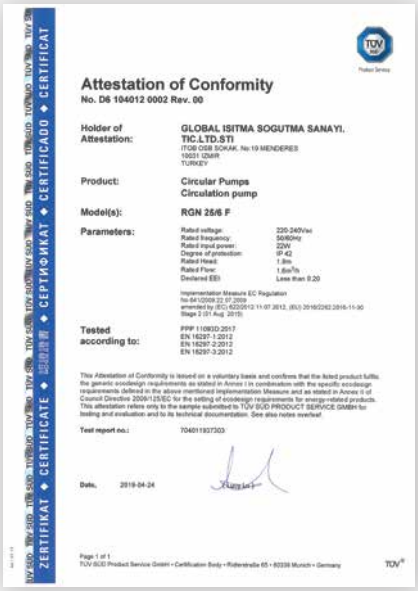

Attestation of Conformity

No. D6 104012 0002 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SANAYI. TIC.LTD.STI
ITOB OSB SOKAK, No:19 MENDERES
35631 IZMIR
TURKEY

Product: Circular Pumps
Circulation pump

Model(s): RGN 25/6 F

Parameters:

Rated voltage:	220-240Vac
Rated frequency:	50/60Hz
Rated input power:	22W
Degree of protection:	IP 42
Rated Head:	1.8m
Rated Flow:	1.6m³/h
Declared EEI:	Less than 0.20

Implementation Measure EC Regulation
No 641/2009 22.07.2009
amended by (EC) 622/2012 11.07.2012, (EU) 2016/2282 2016-11-30
Stage 2 (01 Aug. 2015)

Tested according to: PPP 11093D:2017
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the sample submitted to TÜV SÜD PRODUCT SERVICE GMBH for testing and evaluation and to its technical documentation. See also notes overleaf.

Test report no.: 704011937303

Date, 2019-04-24

(Lucy Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Certification Body • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®



Attestation of Conformity

No. D6 104012 0001 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SANAYI. TIC.LTD.STI
ITOB OSB SOKAK, No:19 MENDERES
35631 IZMIR
TURKEY

Product: Circular Pumps
Circulation pump

Model(s): RGN 25/7 F

Parameters:

Rated voltage:	220-240Vac
Rated frequency:	50/60Hz
Rated input power:	38W
Degree of protection:	IP 42
Rated Head:	2.3m
Rated Flow:	1.8m³/h
Declared EEI:	Less than 0.20

Implementation Measure EC Regulation
No 641/2009 22.07.2009
amended by (EC) 622/2012 11.07.2012, (EU) 2016/2282 2016-11-30
Stage 2 (01 Aug. 2015)

Tested according to: PPP 11093D:2017
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the sample submitted to TÜV SÜD PRODUCT SERVICE GMBH for testing and evaluation and to its technical documentation. See also notes overleaf.


Test report no.: 704011937304

Date, 2019-04-24

(Lucy Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Certification Body • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®

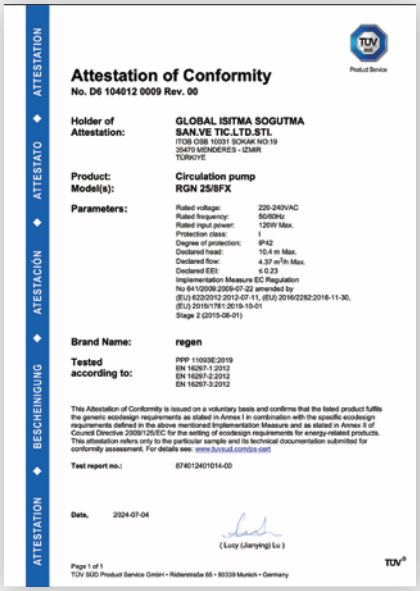

Attestation of Conformity

No. D6 104012 0009 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SAN.VE TIC.LTD.STI.
ITOB OSB 10031 SOKAK NO:19
35470 MENDERES - IZMIR
TÜRKIYE

Product: Circulation pump
Model(s): RGN 25/8FX

Parameters:

Rated voltage:	220-240VAC
Rated frequency:	50/60Hz
Rated input power:	120W Max.
Protection class:	I
Degree of protection:	IP42
Declared head:	10.4 m Max.
Declared flow:	4.37 m³/h Max.
Declared EEI:	≤ 0.23

Implementation Measure EC Regulation
No 641/2009 2009-07-22 amended by
(EU) 622/2012 2012-07-11, (EU) 2016/2282 2016-11-30,
(EU) 2019/1781 2019-10-01
Stage 2 (2015-08-01)

Brand Name: regen

Tested according to: PPP 11093E:2019
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the particular sample and its technical documentation submitted for conformity assessment. For details see: www.tuvsud.com/ps-cert


Test report no.: 874012401014-00

Date, 2024-07-04

(Lucy (Jianying) Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®

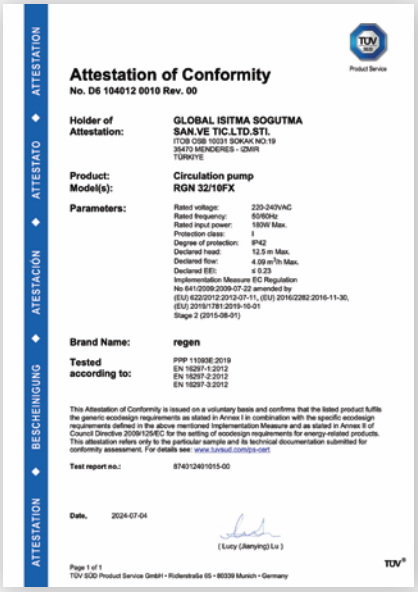

Attestation of Conformity

No. D6 104012 0010 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SAN.VE TIC.LTD.STI.
ITOB OSB 10031 SOKAK NO:19
35470 MENDERES - IZMIR
TÜRKIYE

Product: Circulation pump
Model(s): RGN 32/10FX

Parameters:

Rated voltage:	220-240VAC
Rated frequency:	50/60Hz
Rated input power:	180W Max.
Protection class:	I
Degree of protection:	IP42
Declared head:	12.5 m Max.
Declared flow:	4.09 m³/h Max.
Declared EEI:	≤ 0.23

Implementation Measure EC Regulation
No 641/2009 2009-07-22 amended by
(EU) 622/2012 2012-07-11, (EU) 2016/2282 2016-11-30,
(EU) 2019/1781 2019-10-01
Stage 2 (2015-08-01)

Brand Name: regen

Tested according to: PPP 11093E:2019
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the particular sample and its technical documentation submitted for conformity assessment. For details see: www.tuvsud.com/ps-cert

Test report no.: 874012401015-00

Date, 2024-07-04

(Lucy (Jianying) Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®



Attestation of Conformity

No. D6 104012 0011 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SAN.VE TIC.LTD.STI.
ITOB OSB 10031 SOKAK NO:19
35470 MENDERES - IZMIR
TÜRKIYE

Product: Circulation pump

Model(s): RGN 32/18 FX

Parameters:

Rated voltage:	220-240V~
Rated frequency:	50/60Hz
Rated input power:	260W
Protection class:	Class I
Degree of protection:	IP44
Declared head:	Max.18m
Declared flow:	11m³/h

Implementation Measure EC Regulation
No 641/2009: 2009-07-22 amended by
(EU) 622/2012 2012-07-11, (EU) 2016/2282: 2016-11-30,
(EU) 2019/1781:2019-10-01
Stage 2(2015-08-01)

Tested according to: PPP 11093E:2019
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the particular sample and its technical documentation submitted for conformity assessment. For details see: www.tuvsud.com/ps-cert


Test report no.: 701282407062-00

Date, 2024-08-29

(Lucy (Jianying) Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®

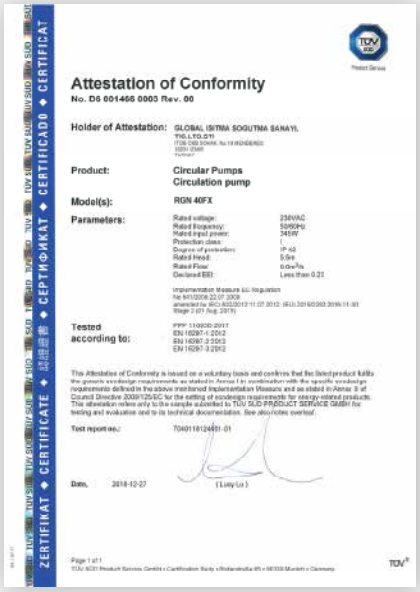

Attestation of Conformity

No. D6 001466 0003 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SANAYI. TIC.LTD.STI
ITOB OSB SOKAK, No:19 MENDERES
35631 IZMIR
TURKEY

Product: Circular Pumps
Circulation pump

Model(s): RGN 40FX

Parameters:

Rated voltage:	234VAC
Rated frequency:	50/60Hz
Rated input power:	345W
Protection class:	I
Degree of protection:	IP 42
Rated Head:	5.5m
Rated Flow:	3.6m³/h
Declared EEI:	Less than 0.23

Implementation Measure EC Regulation
No 641/2009 22.07.2009
amended by (EC) 622/2012 11.07.2012, (EU) 2016/2282 2016-11-30
Stage 2 (01 Aug. 2015)

Tested according to: PPP 11093D:2017
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the sample submitted to TÜV SÜD PRODUCT SERVICE GMBH for testing and evaluation and to its technical documentation. See also notes overleaf.

Test report no.: 704011812401-01

Date, 2018-12-27

(Lucy Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Certification Body • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®



Attestation of Conformity

No. D6 001466 0003 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SANAYI. TIC.LTD.STI
ITOB OSB SOKAK, No:19 MENDERES
35631 IZMIR
TURKEY

Product: Circular Pumps
Circulation pump

Model(s): RGN 50FX

Parameters:

Rated voltage:	220VAC
Rated frequency:	50/60Hz
Rated input power:	540W
Protection class:	I
Degree of protection:	IP 42
Rated Head:	8.5m
Rated Flow:	6.0m³/h
Declared EEI:	Less than 0.23

Implementation Measure EC Regulation
No 641/2009 22.07.2009
amended by (EC) 622/2012 11.07.2012, (EU) 2016/2282 2016-11-30
Stage 2 (01 Aug. 2015)

Tested according to: PPP 11093D:2017
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the sample submitted to TÜV SÜD PRODUCT SERVICE GMBH for testing and evaluation and to its technical documentation. See also notes overleaf.

Test report no.: 704011812401-01

Date, 2018-12-27

(Lucy Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Certification Body • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®



Attestation of Conformity

No. D6 001466 0003 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SANAYI. TIC.LTD.STI
ITOB OSB SOKAK, No:19 MENDERES
35631 IZMIR
TURKEY

Product: Circular Pumps
Circulation pump

Model(s): RGN 65FX

Parameters:

Rated voltage:	230VAC
Rated frequency:	50/60Hz
Rated input power:	345W
Protection class:	I
Degree of protection:	IP 42
Rated Head:	5.5m
Rated Flow:	9.0m³/h
Declared EEI:	Less than 0.23

Implementation Measure EC Regulation
No 641/2009 22.07.2009
amended by (EC) 622/2012 11.07.2012, (EU) 2016/2282 2016-11-30
Stage 2 (01 Aug. 2015)

Tested according to: PPP 11093D:2017
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the sample submitted to TÜV SÜD PRODUCT SERVICE GMBH for testing and evaluation and to its technical documentation. See also notes overleaf.

Test report no.: 704011812401-01

Date, 2018-12-27

(Lucy Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Certification Body • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®



Attestation of Conformity

No. D6 104012 0012 Rev. 00

Holder of Attestation: GLOBAL ISITMA SOGUTMA SAN.VE TIC.LTD.STI.
ITOB OSB 10031 SOKAK NO:19
35470 MENDERES - IZMIR
TÜRKIYE

Product: Circulation pump

Model(s): RGN 80/15 FX

Parameters:

Rated voltage:	230V~
Rated frequency:	50/60Hz
Rated input power:	1314W
Protection class:	Class I
Degree of protection:	IP44
Declared head:	Max.12m
Declared flow:	65m³/h

Implementation Measure EC Regulation
No 641/2009: 2009-07-22 amended by
(EU) 622/2012 2012-07-11, (EU) 2016/2282: 2016-11-30,
(EU) 2019/1781:2019-10-01
Stage 2(2015-08-01)

Tested according to: PPP 11093E:2019
EN 16297-1:2012
EN 16297-2:2012
EN 16297-3:2012

This Attestation of Conformity is issued on a voluntary basis and confirms that the listed product fulfils the generic ecodesign requirements as stated in Annex I in combination with the specific ecodesign requirements defined in the above mentioned Implementation Measure and as stated in Annex II of Council Directive 2009/125/EC for the setting of ecodesign requirements for energy-related products. This attestation refers only to the particular sample and its technical documentation submitted for conformity assessment. For details see: www.tuvsud.com/ps-cert

Test report no.: 701282407063-00

Date, 2024-08-29

(Lucy (Jianying) Lu)

Page 1 of 1
TÜV SÜD Product Service GmbH • Ridlerstraße 65 • 80339 Munich • Germany

TÜV®



Akışta Kal, Enerjini Koru.

regen

GLOBAL ISITMA SOĞUTMA
SAN. TİC. LTD. ŞTİ.

İTOB O.S.B. 10017 Sk. N.6
Menderes, İZMİR, TURKEY

+90.232. 469 29 94

www.regenpompa.com
info@regenpompa.com